

FIRE DETECTION SYSTEM SCHEDULE	
SYMBOL	DESCRIPTION
	SMOKE DETECTOR MOUNTED ON SURFACE AGAINST CEILING OR SLAB
	SMOKE DETECTORS MOUNTED IN CEILING VOID
	HEAT DETECTORS MOUNTED SURFACE AGAINST CEILING & SLAB
	MULTI-FUNCTION SMOKE / HEAT DETECTORS MOUNTED AS REQUIRED
	ADDRESSABLE CALL POINT
	FIRE ALARM STROBE AND HORN COMBINATION
	ALARM SIREN
	FIRE DETECTOR PANEL WITH BATTERY UNIT NEXT TO IT
	LINE ISOLATOR
	INTERFACE ADDRESSABLE RELAY
	IDENTIFICATION NUMBER
	RELAY FOR EXTRACT FANS
	AUXILIARY ENCLOSURE
	FD CABLE CONNECTION
NOTES :	
1. FIRE DETECTION CONDUITS SHALL BE 250 BOSAL STEEL TUBE, PAINTED YELLOW.	
2. ALL THE BOXES IN THE CEILING AND SLAB SHALL BE 60 DIAMETER ROUND BOXES.	
3. BOXES FOR THE BREAKGLASS SHALL BE 100 x 50 x 50mm DRAW BOXES.	

The design and content of this drawing is the property of
KCS Architects and the copyright therein is reserved by them.

GENERAL NOTE

1. ALL INFORMATION, INCLUDING, BUT NOT LIMITED TO, THE DESIGN, CONSTRUCTION, AND MAINTENANCE OF THE FACILITY, SHALL BE THE PROPERTY OF THE CLIENT. THE CLIENT SHALL BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE DESIGNER. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

2. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

3. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

4. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

5. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

6. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

7. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

8. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

9. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.


10. THE DESIGNER SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED TO THE CLIENT.

No	Date	Revision Description	By
PROJECT TEAM			
Project Managers			
Architects			
Quantity Surveyors			
Civil Engineers			
Structural Engineers			
Electrical & Mechanical Engineers			
CLIENT			
CLIENT APPROVAL			
DATE			
TENANT			
NAME			
DESIGNATION			
TENANT APPROVAL			
DATE			
Project			
EB/NW1/10/24/Z1A			
Drawing Title			
Fire Detection to Sequencing Facility			
Date			
Scale			
1:200			
Checked			
D.P.			
Approved			
Name			
Signature			
Practitioner			
Reg No.			
Date			
For Tender Purposes			
Drawing Number			
3244-FD-01			
Revision			
0			

28 May 2025 15:05:12



PLAN VIEW ON RECEIVING ADMIN OFFICE
SCALE 1:100

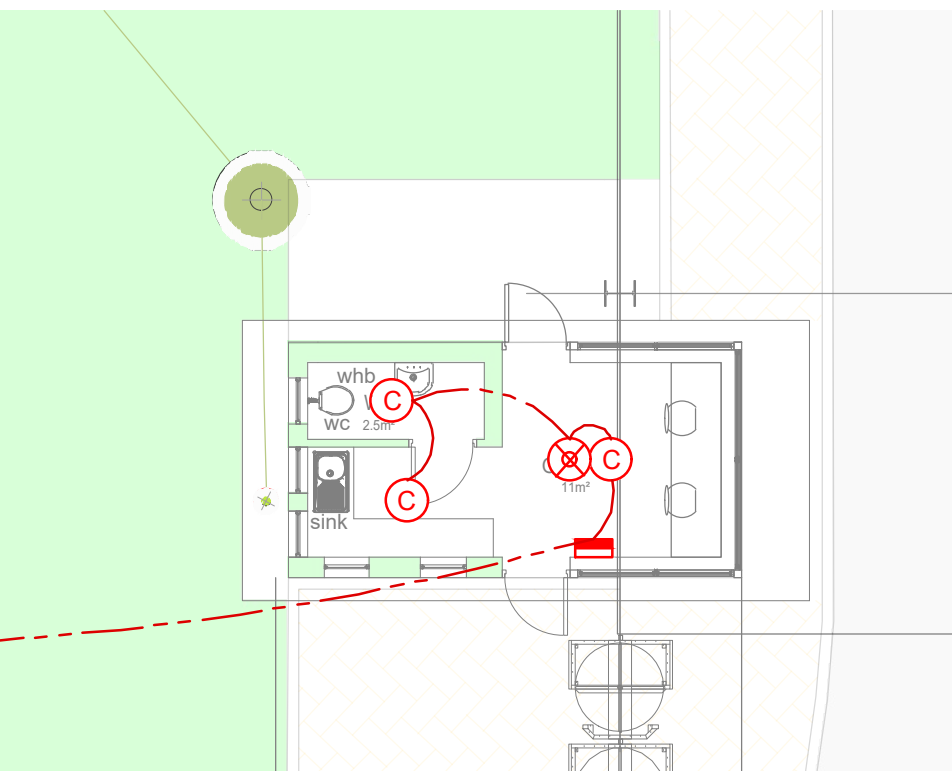

PLAN VIEW ON GATEHOUSE
SCALE 1:100