
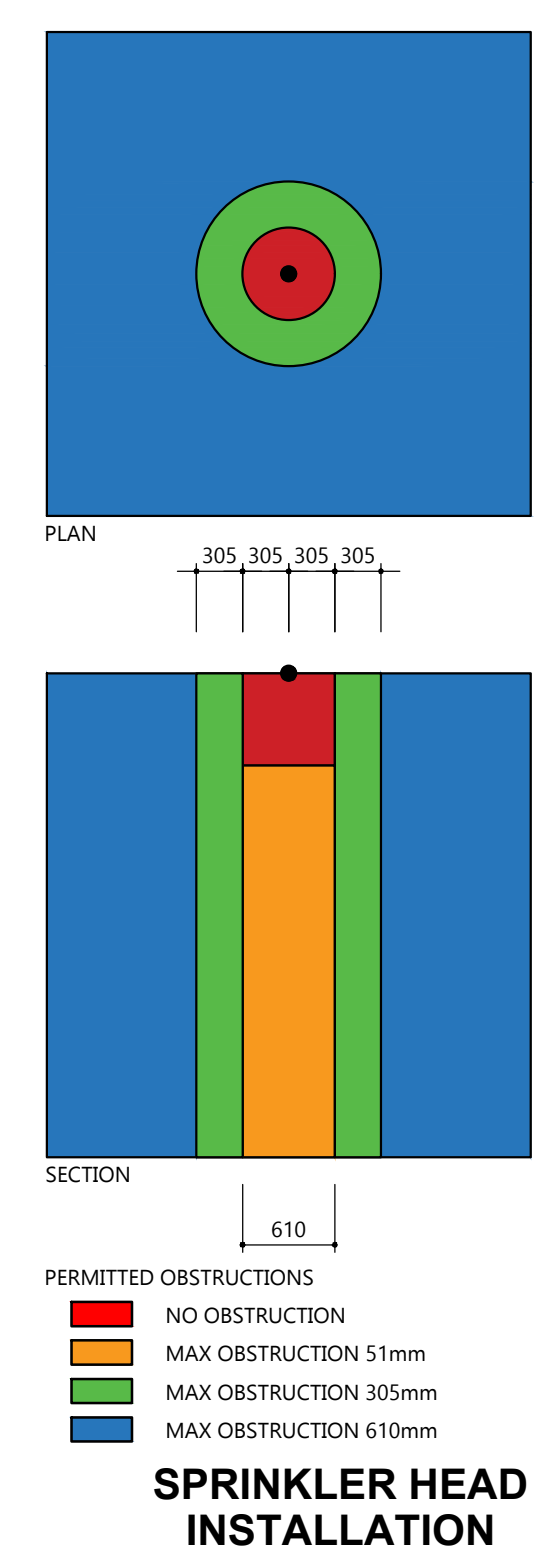



PIPING NOTES

1. FIRE PROTECTION PIPING SUPPLY MAIN TO BE 250NB SCH 40, GALVANISED
2. FIRE PROTECTION PIPING IN (EARTHEN) TRENCHES TO BE AS FOLLOWS:
 - Type Class 16
 - Fully Galvanised, including flanges, nuts, bolts and washers
 - Complete pipework installation, to be degraded using Plicon - GRI - 1
 - Adequate thickness of approved supplier equivalent for Wrapsold Bond application
 - Putty around all flange connections, including both cluster for sealed Wrapsold installation
 - Wrapold Bond complete underground pipe installation, to Camusa-CPS specification
3. ALL FIRE PROTECTION PIPING AND INSTALLATION THEREOF TO COMPLY WITH NATIONAL REGULATORY REGULATIONS

SPRINKLER NOTES:-

1. MAXIMUM AREA OF SPRINKLERS IN OPERATION = 260m²
2. SPRINKLER K FACTOR = 11.5
3. DESIGN LINE DENSITY = 17.5
4. SPRINKLER OPERATING PRESSURE = 130kPa
5. FLOW PER SPRINKLER = 131 l/min.
6. SYSTEM MAXIMUM FLOW = 7184 l/min.

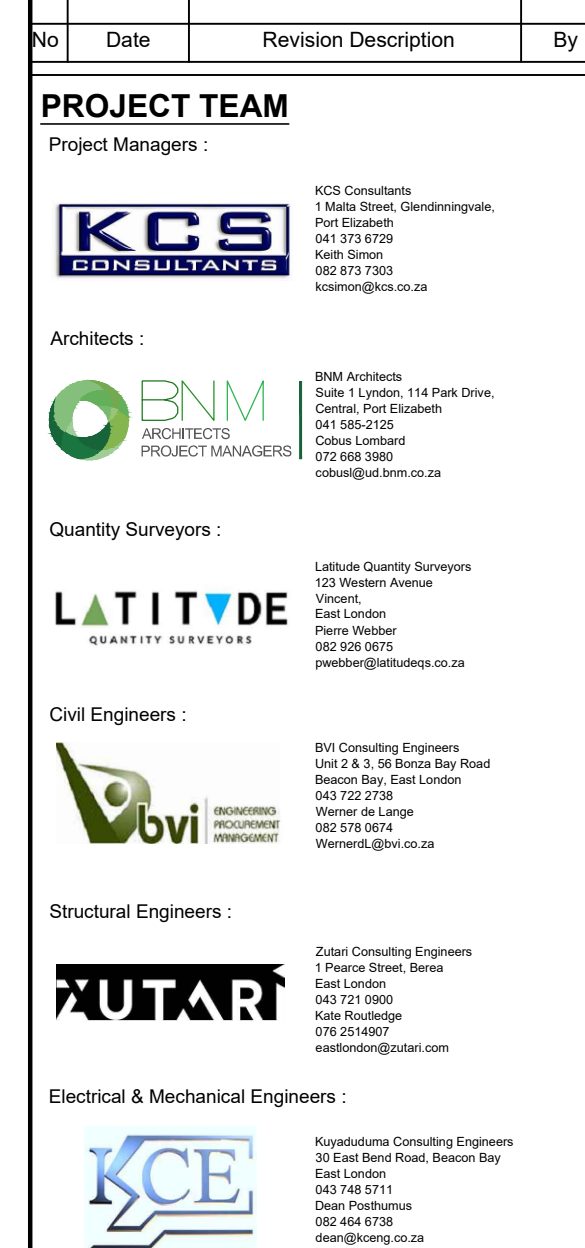

CLIENT  east london idz <i>business streamlined</i>		PO Box 4446, Onefourth East London 1008 Lower Cheam Road Surbiton, Surrey, UK TW20 9LW Tel: +44(0)181903030 Fax: +44(0)181903030 Email: info@eastlondonidz.co.uk	
CLIENT APPROVAL: _____ DATE: _____		(day) Website: (night) Email: Tel: 020 3452 0477 Cell: 078 3452 0477 E-mail: griffiths@idz.co.uk	
TENANT			
NAME: _____ DESIGNATION: _____		TENANT APPROVAL: _____ DATE: _____	
Project EB/NW/1/10/24/21A			
Drawing Title Fire Sprinklers to Sequencing Facility			
Date 10/10/2024	Drawn 1 : 200	Drawn Checked	B.M.E. D.P.
Approved Name: _____ Reg No: _____ Signature: _____ Date: _____ Practise: _____			
Workstage <div style="font-size: 2em; font-weight: bold; margin-top: 10px;">For Tender Purposes</div>			
Drawing Number: 3244-PP-02			Revision <div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; display: flex; align-items: center; justify-content: center; margin: 0 auto;"> <div style="border-top: 1px solid black; border-bottom: 1px solid black; width: 10px; height: 10px;"></div> </div>