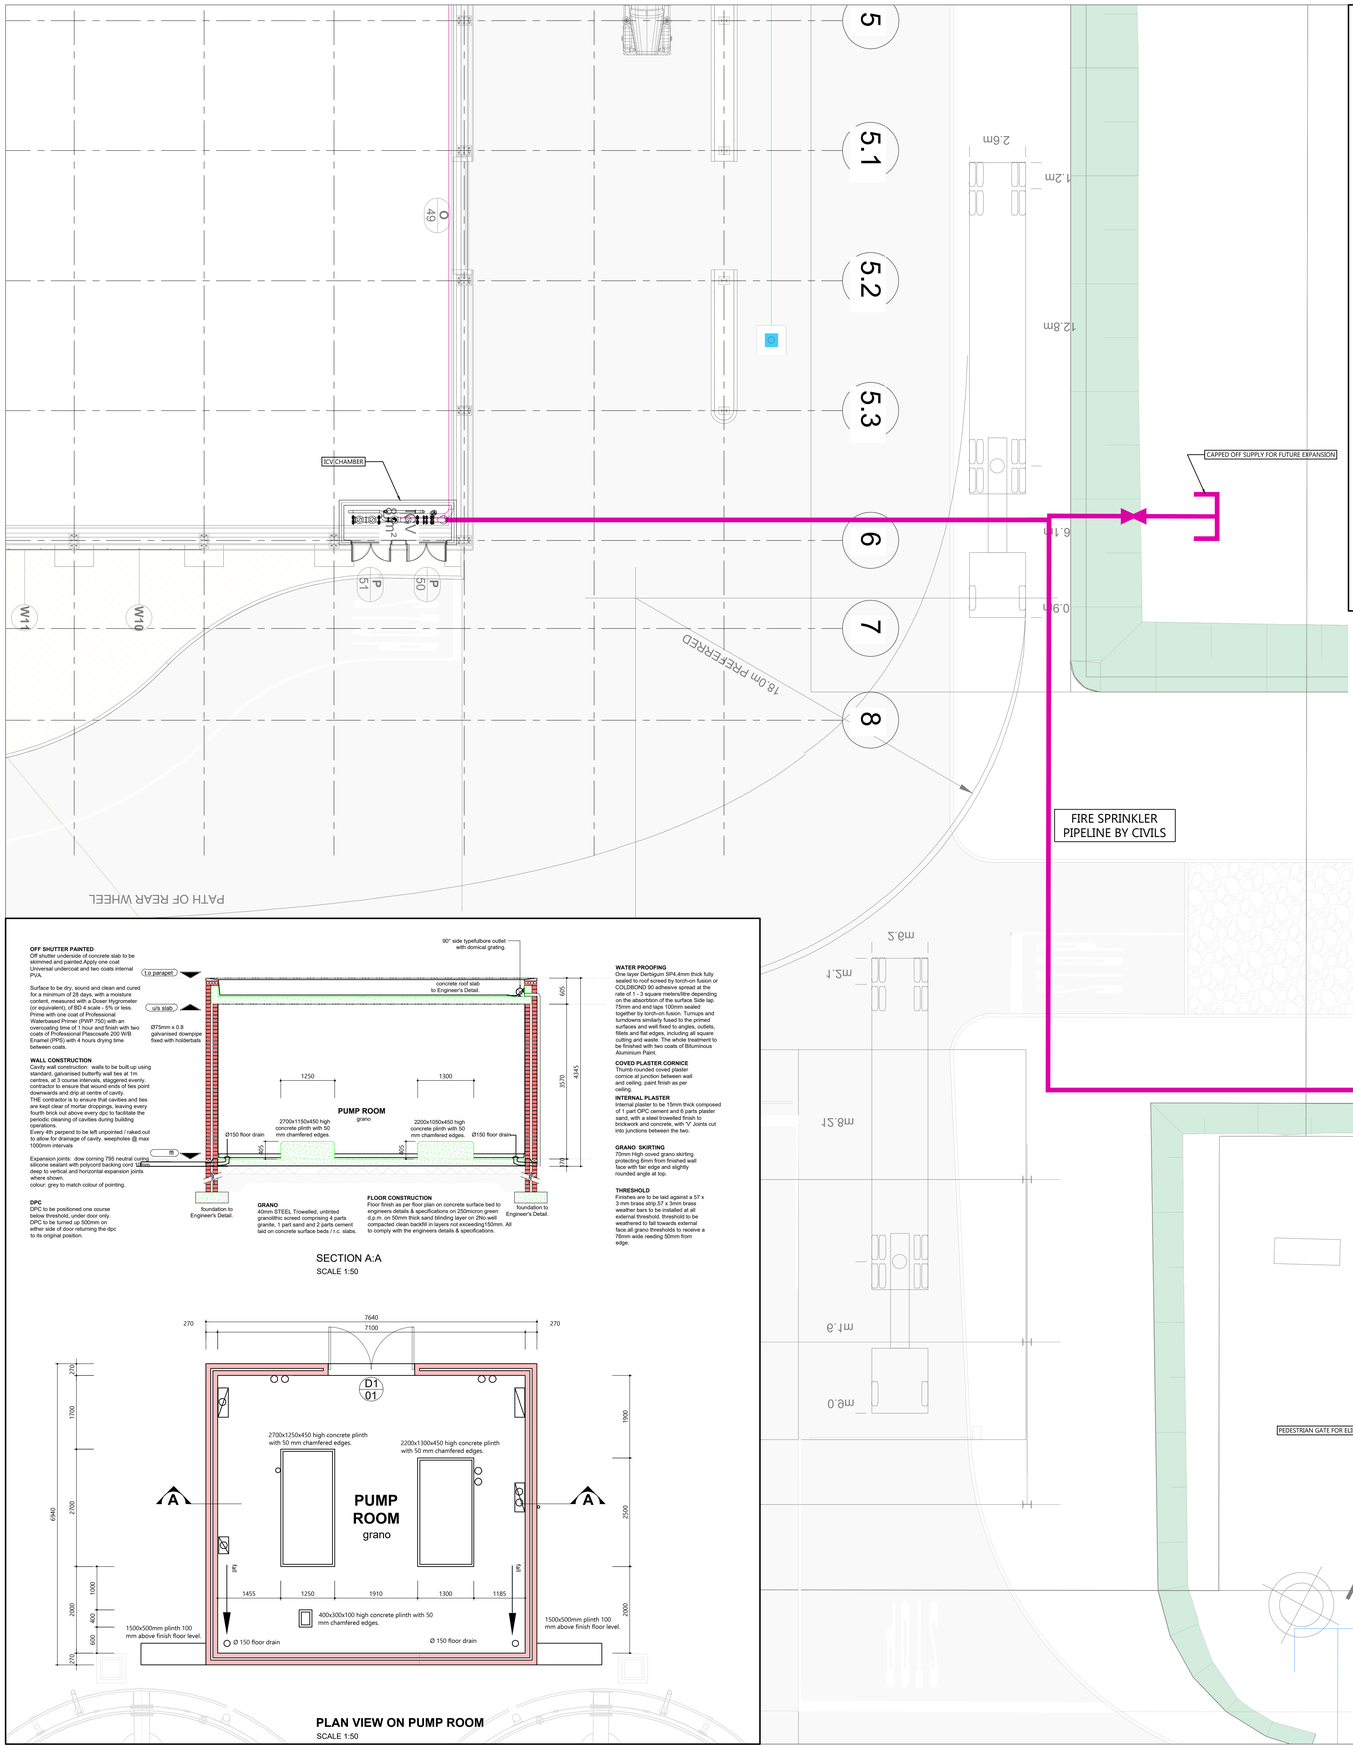

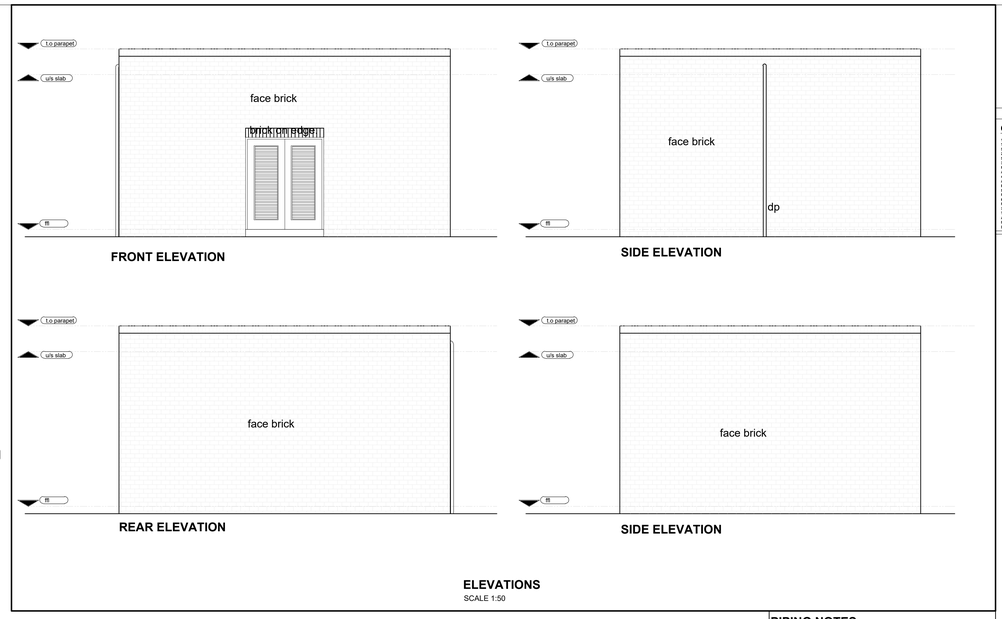

ELEVATIONS
SCALE 1:50

PIPING NOTES

1. FIRE PROTECTION PIPING SUPPLY MAIN TO BE 250NB SCH 40, GALVANISED
2. FIRE PROTECTION PIPING IN (EARTHEN) TRENCHES TO BE AS FOLLOWS:
   - Type Class 16
   - Fully Galvanized, including flanges, nuts, bolts and washers
   -Complete pipework installation, to be degreased using Plascon - GR1 - Aquaoliv - Degreaser of approved supplier equivalent for Wrapid Bond application
   - Putty around all flange connections, including bolt cluster for sealed Wrapid Bond installation
   -Wrapid Bond complete underground pipe installation, to Canusa-CPS specification
3. ALL FIRE PROTECTION PIPING AND INSTALLATION THEREOF TO COMPLY WITH NATIONAL RELEVANT REGULATIONS

PLAN VIEW ON PUMP ROOM
SCALE 1:50

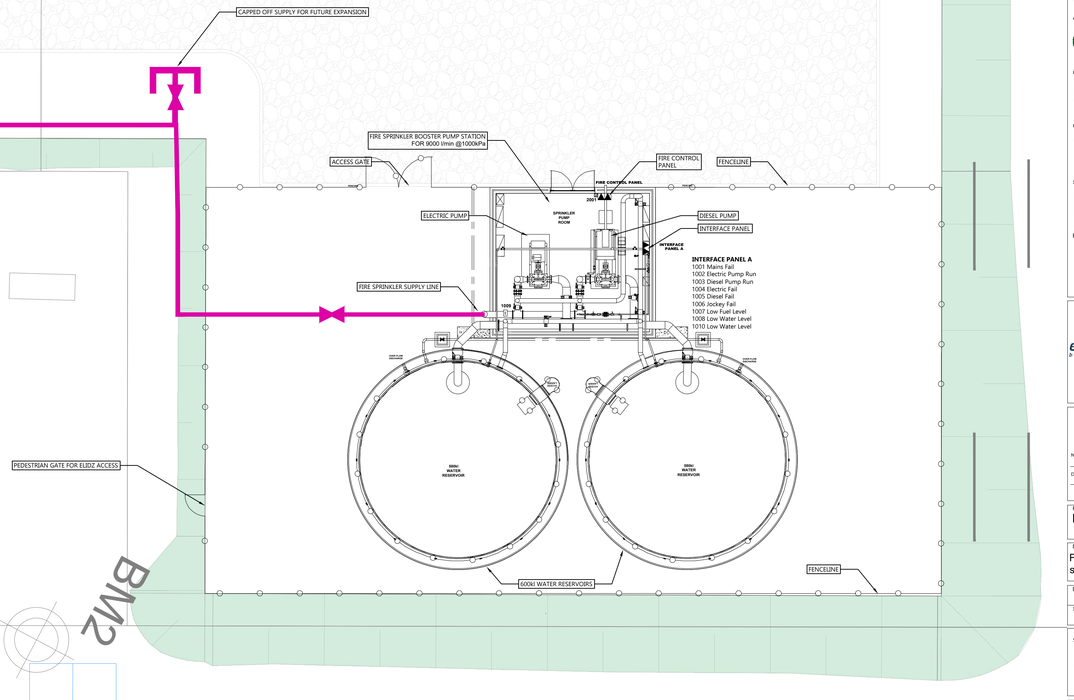

SITE PLAN
SCALE 1:100

The design and content of this drawing is the property of BNM Architects and it's copyright thereof is reserved by them.

GENERAL NOTE

1. ALL STRUCTURAL, ELECTRICAL, CIVIL AND LANDSCAPING QUERIES ARE TO BE REFERRED TO THE RELEVANT CONSULTANTS DRAWINGS, SPECIFICATIONS AND DETAILS.
2. ALL PLUMBING QUERIES ARE TO BE REFERRED TO THE RELEVANT SPECIALIST CONSULTANTS DRAWINGS, SPECIFICATIONS AND DETAILS
3. ALL BRICKWORK, BLOCKWORK AND CONCRETE WORK TO BE REFERRED TO PR. STRUCTURAL ENGINEER'S DRAWINGS, SPECIFICATIONS AND DETAILS.
4. ALL RETAINING WALLS / INTERNAL WALLS REQUIRING BRACING / STIFFENING ARE TO BE CONSTRUCTED IN ACCORDANCE WITH PR. STRUCTURAL ENGINEER'S DRAWINGS, SPECIFICATIONS AND DETAILS
5. ALL ROOF CONSTRUCTIONS TO BE REFERRED TO SPECIALISTS DRAWINGS, SPECIFICATIONS AND DETAILS. TO BE REFERRED TO CONSULTANTS DRAWINGS, SPECIFICATIONS AND DETAILS.
6. ALL DESIGN AND CONSTRUCTION TO COMPLY WITH THE RELEVANT SANS CODE OF PRACTICE
7. ANY DISCREPANCY IN THE DRAWINGS, DIMENSIONS & SPECIFICATIONS TO BE REPORTED TO THE ARCHITECT BEFORE ANY WORK IS CARRIED OUT
8. ARCHITECT PRIOR TO ANY WORK BEING PUT IN HAND
9. ONLY FIGURED DIMENSIONS TO BE FOLLOWED - SCALED DIMENSIONS OF DRAWINGS WILL NOT BE PERMITTED

No	Date	Revision Description	By

PROJECT TEAM

Project Managers :
KCS Consultants
1 Malta Street, Glendinningvale, East London, 5241
Cell: 072 672 6726
Keith Simon
043 726 1000
keithsim@kcs.co.za

Architects :
BNM Architects
Suite 1 Lyndon, 114 Park Drive, Vincent, East London
Cell: 083 235 2125
043 748 0990
info-el@bnm.co.za

Quantity Surveyors :
Latitude Quantity Surveyors
122 Western Avenue
Vincent
East London
Petra Walker
082 926 0675
pwalker@latitudeqs.co.za

Civil Engineers :
BVI Consulting Engineers
Unit 1, 1 Fleet Street, Road Reserve Rise, Red Limber
043 723 3738
Gerhard Lotter
082 378 5474
lotterehl@bvi.co.za

Structural Engineers :
Zutari Consulting Engineers
1 Fleet Street, Berea
East London
Cell: 082 926 0675
Kate Routledge
078 251 6957
eastlondon@zutari.com

Electrical & Mechanical Engineers :
Kzyadoluma Consulting Engineers
50 East Bank Road, Beacon Bay
East London
043 748 0990
Deon Potgieter
082 464 9730
deon@kcemep.co.za

CLIENT

east london idz
business streamlined

PO Box 5458, Greenfields
East London, 5208

Lower Chester Road
Sunnyridge, 5201
East London, South Africa

Tel: +27(0)437039200
Fax: +27(0)437369403
Email: info@elidz.co.za

CLIENT APPROVAL :
DATE :

Gary Whittaker
Project Manager
Tel: 043 7025247
Cell: 082 3463299
E-mail: garyw@elidz.co.za

TENANT

NAME :
DESIGNATION :
TENANT APPROVAL :
DATE :

Project
EB/NW1/10/24/Z1A

Drawing Title
Fire Sprinkler Booster Pump station

Date	10/10/2024	Drawn	B.M.E.
Scale	1 : 100	Checked	D.P.

Approved
Name: -
Reg No: -
Signature:
Date:
Practice:

Workstage
For Tender Purposes

Drawing Number
3244-FP-09

Revision
0

23 May 2025 09:15:26