




MAIN ADMIN OFFICE - FIRST FLOOR
SCALE 1:50

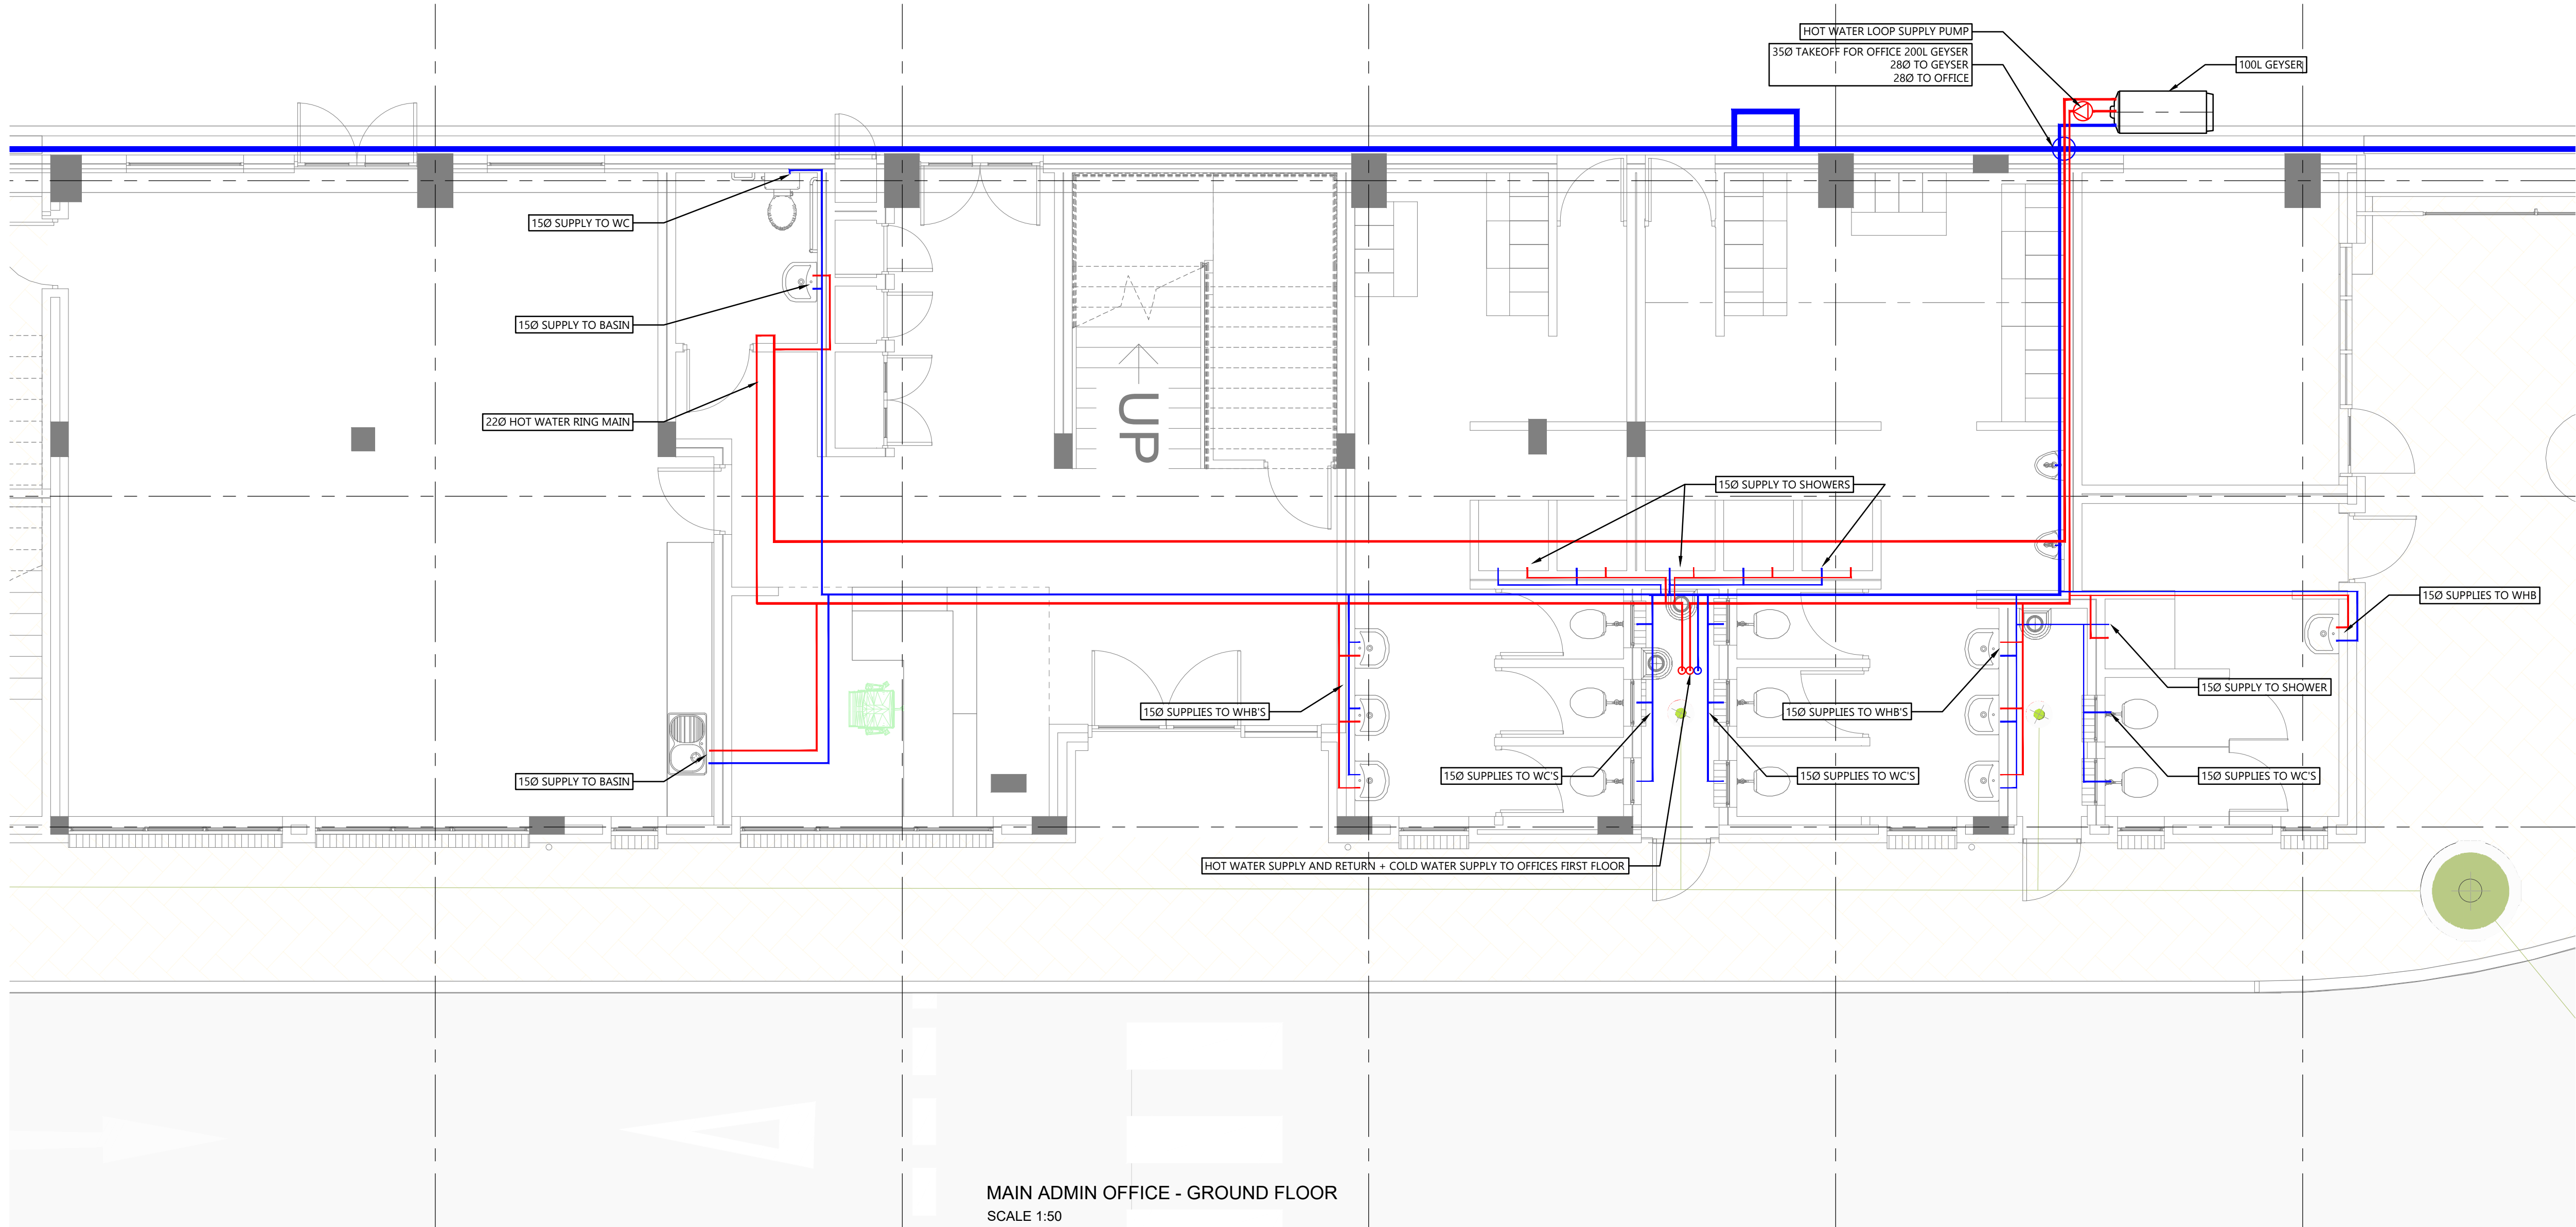

MAIN ADMIN OFFICE - GROUND FLOOR
SCALE 1:50

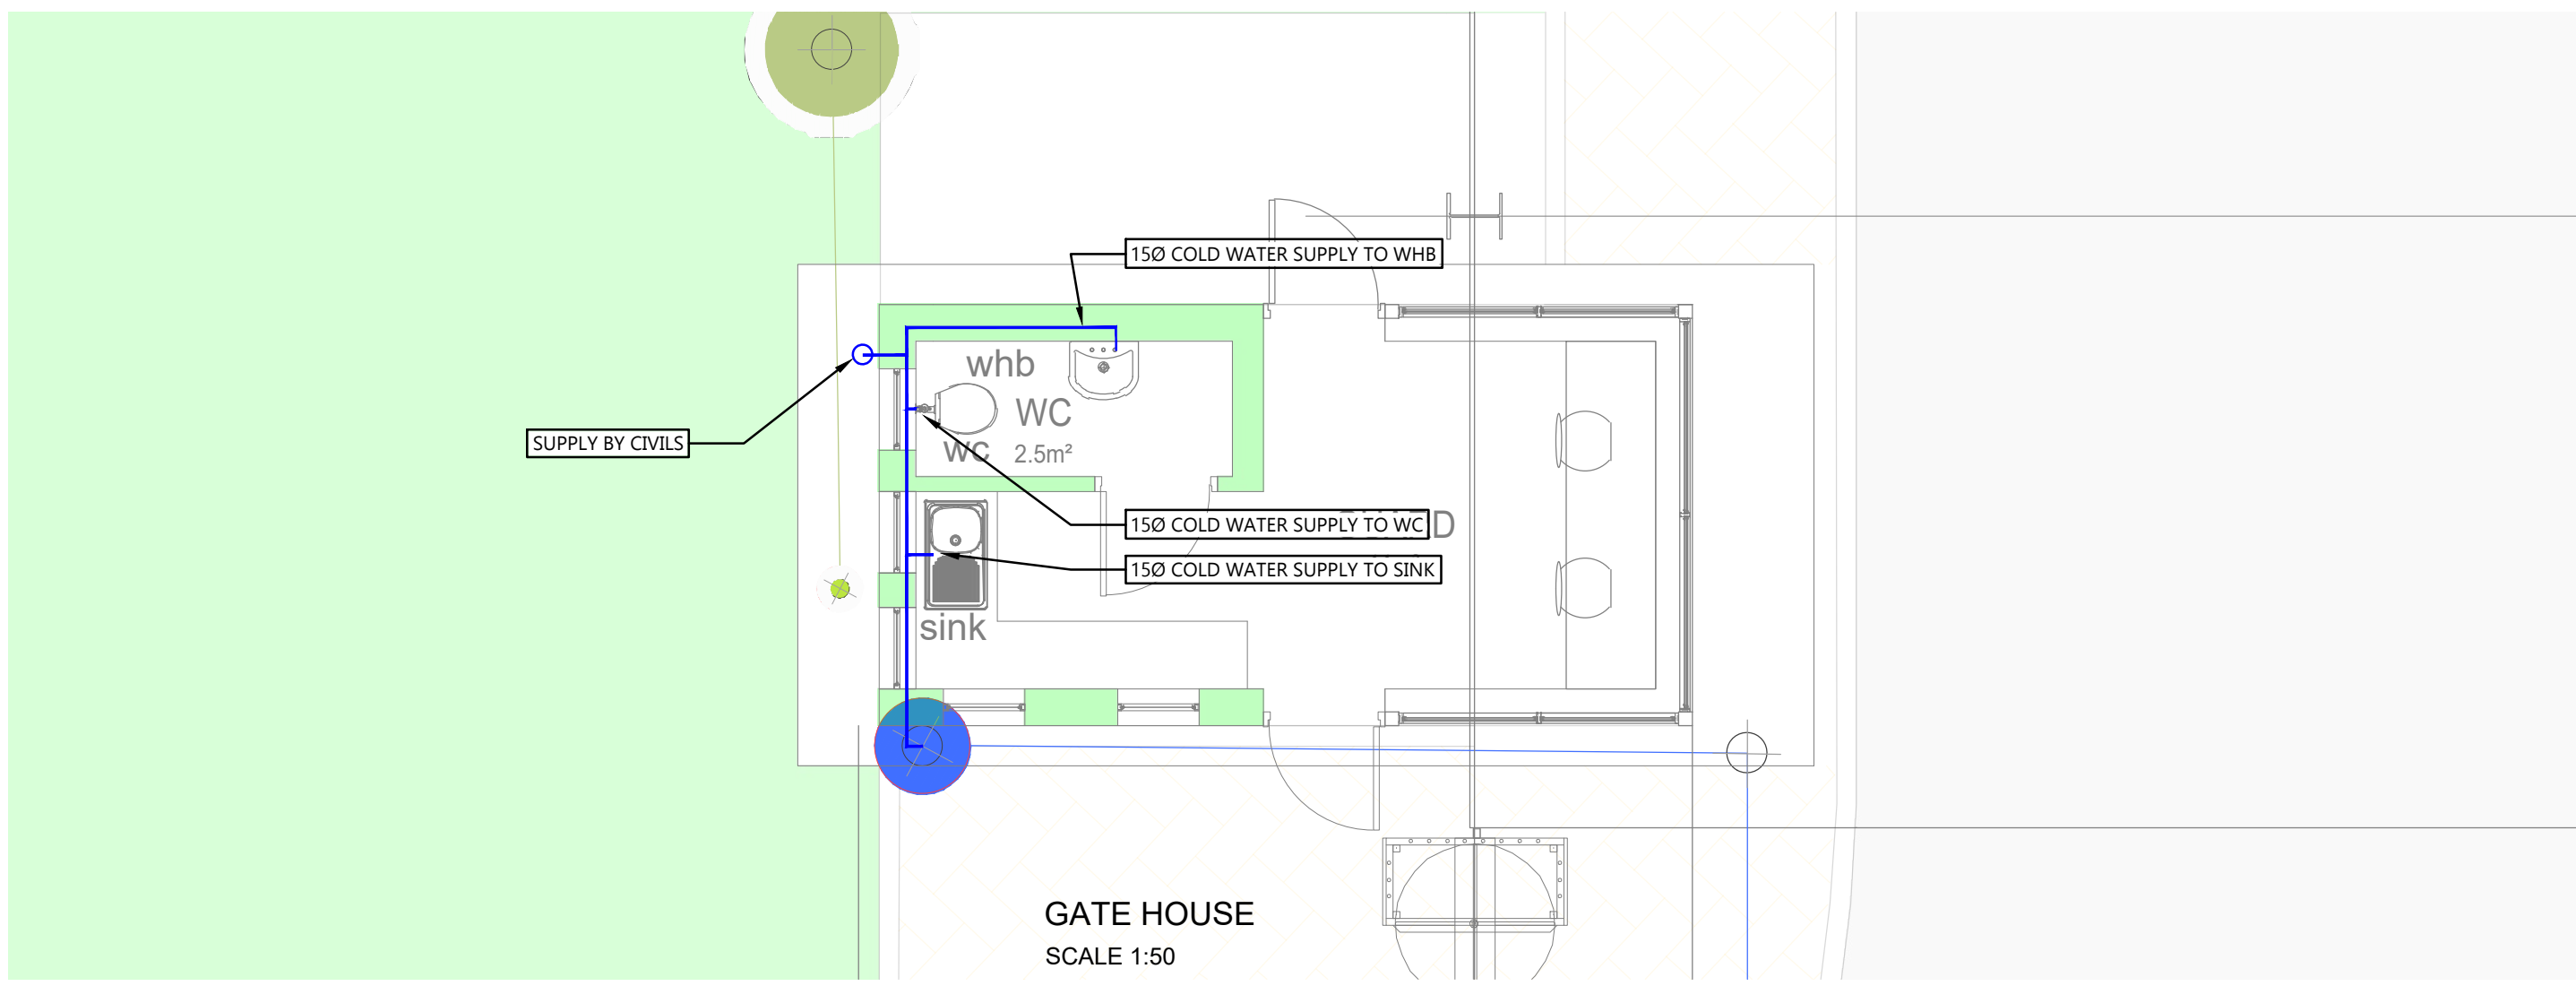

GATE HOUSE
SCALE 1:50

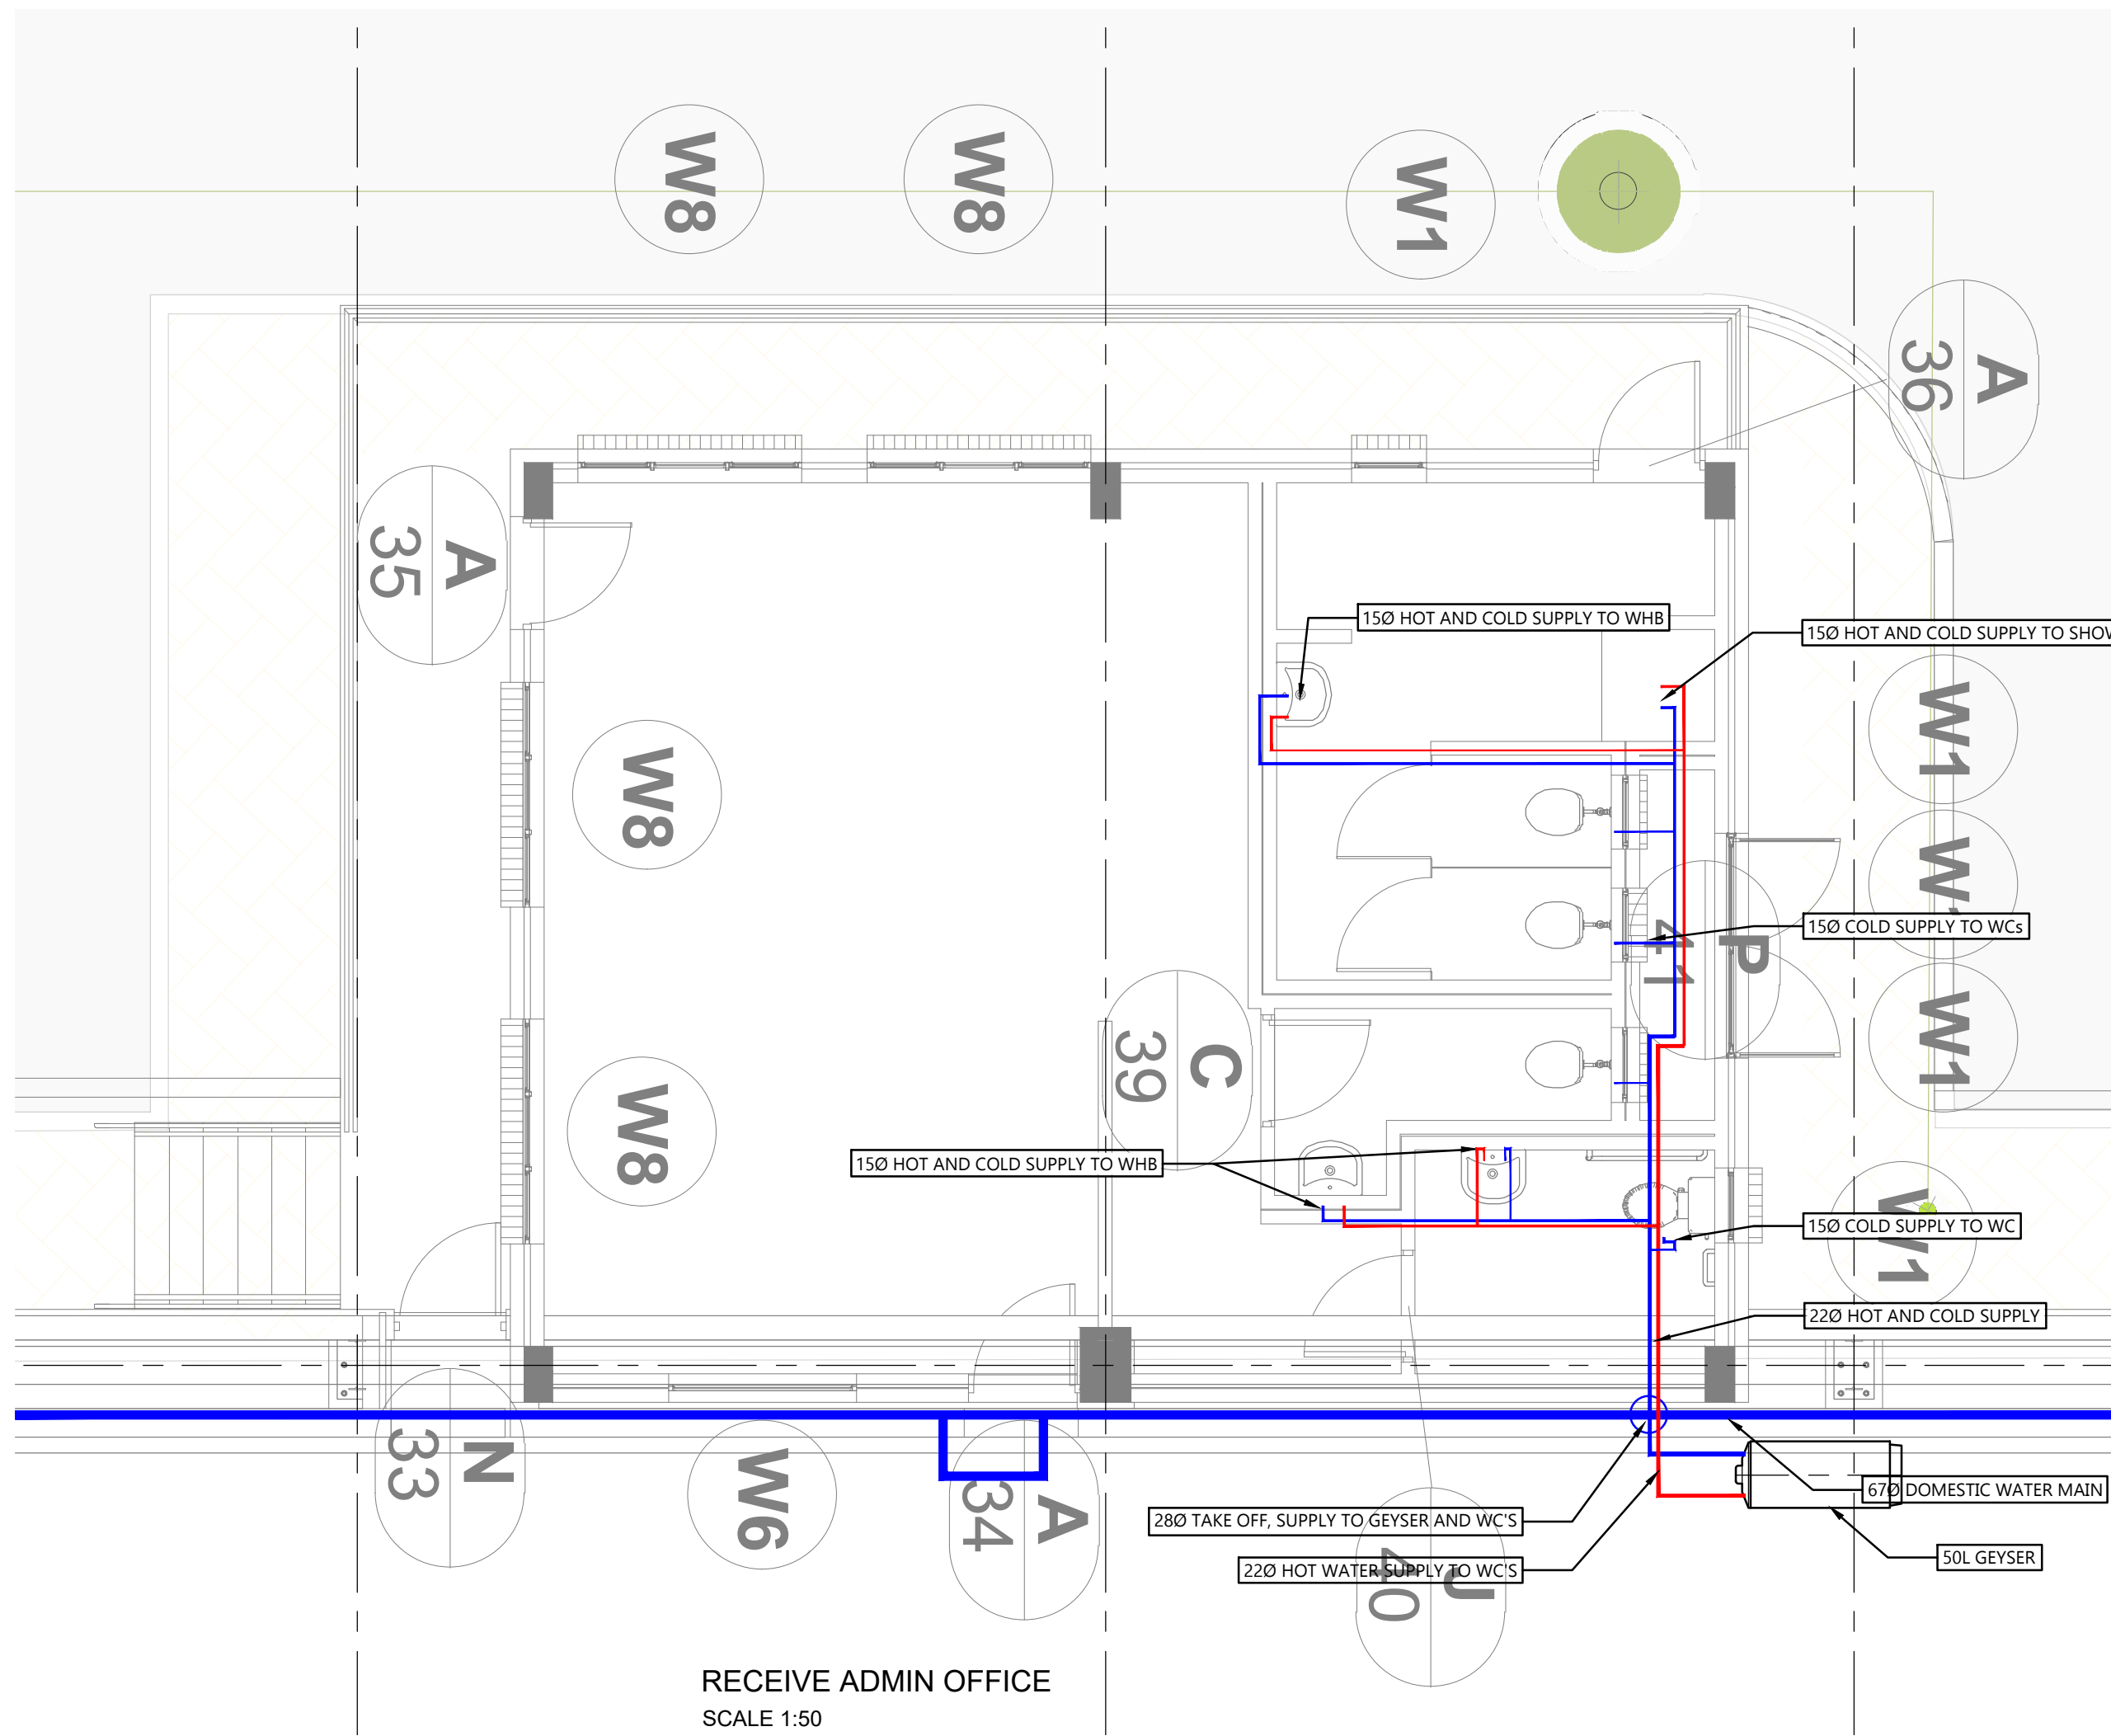

RECEIVE ADMIN OFFICE
SCALE 1:50

Legend / Quantities				
Item	Type	Unit	Hot Water	Cold Water
Pipe	350 Cu	m	12	
Pipe	280 Cu	m	20	
Pipe	220 Cu	m	120	6
Pipe	150 Cu	m	64	160
Elbow	350		0	4
Elbow	280			15
Elbow	220		25	6
Elbow	150		50	35
Tee	350		0	4
Tee	280		0	4
Tee	220		17	20
Tee	150		10	2
Reducer	350>22		0	5
Reducer	350>15		0	5
Reducer	220>15		10	30
Union	220		20	15
Union	150		20	25
Valve	350		1	1
Valve	280		1	1
Valve	220		2	2
Valve	150		0	0
Vacuum Breaker	220		1	
Safety Valve	220		2	
Geyser	100 Liter + Tray		1	
Geyser	50 Liter + Tray		1	
Circ Pump	Wlo. 5l / minute		1	

The design and content of this drawing is the property of
KCS CONSULTANTS and the copyright therein is reserved by them.

GENERAL NOTE

1. ALL DIMENSIONS ARE IN METERS. DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
2. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
3. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
4. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
5. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
6. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
7. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
8. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
9. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
10. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
11. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
12. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
13. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
14. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
15. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
16. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
17. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
18. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
19. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
20. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
21. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
22. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
23. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
24. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
25. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
26. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
27. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
28. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
29. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
30. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
31. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
32. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
33. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
34. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
35. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
36. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
37. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
38. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
39. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
40. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
41. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
42. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
43. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
44. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
45. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
46. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
47. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
48. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
49. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
50. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
51. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
52. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
53. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
54. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
55. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
56. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
57. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
58. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
59. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
60. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
61. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
62. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
63. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
64. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
65. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
66. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
67. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
68. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
69. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
70. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
71. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
72. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
73. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
74. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
75. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
76. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
77. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
78. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
79. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
80. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
81. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
82. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
83. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
84. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
85. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
86. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
87. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
88. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
89. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
90. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
91. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
92. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
93. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
94. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
95. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
96. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
97. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
98. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
99. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.
100. ALL DIMENSIONS ARE TO FACE UNLESS OTHERWISE SPECIFIED.

No Date Revision Description By

PROJECT TEAM

Project Managers:

KCS CONSULTANTS

Architects:

BNM

Quantity Surveyors:

LATITUDE

Civil Engineers:

Avi

Structural Engineers:

AUTAR

Electrical & Mechanical Engineers:

KCE

CLIENT

east london idz

CLIENT APPROVAL:

DATE:

TENANT

NAME: _____ TENANT APPROVAL: _____

DESIGNATION: _____ DATE: _____

Project: **EB/NW1/10/24/Z1A**

Drawing Title: **Domestic Hot and Cold Water to Offices**

Date: 10/10/2024 Drawn: B.M.E.

Scale: 1:100 Checked: D.P.

Approved

Name: _____ Reg No: _____

Signature: _____ Date: _____

Practice: _____

For Tender Purposes

Drawing Number: **3244-FP-08**

Revision: **0**